




**CEMENT CONCRETE SIDEWALK  
ADJACENT TO CURB**

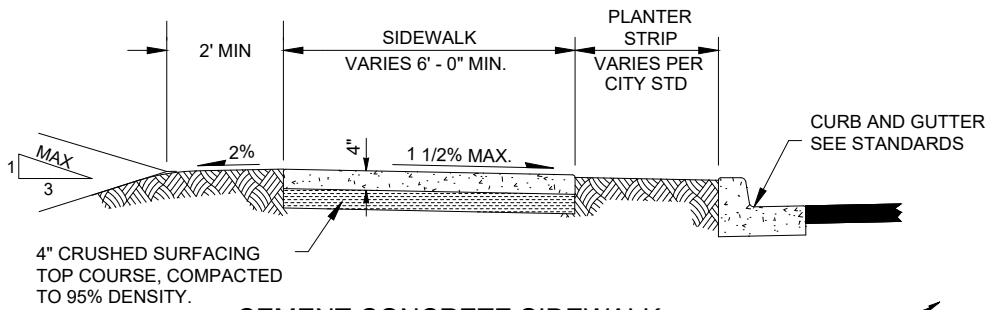


**CEMENT CONCRETE SIDEWALK  
ADJACENT TO PLANTER STRIP**



**(C) CONTRACTION JOINT**



**(E) EXPANSION JOINT**

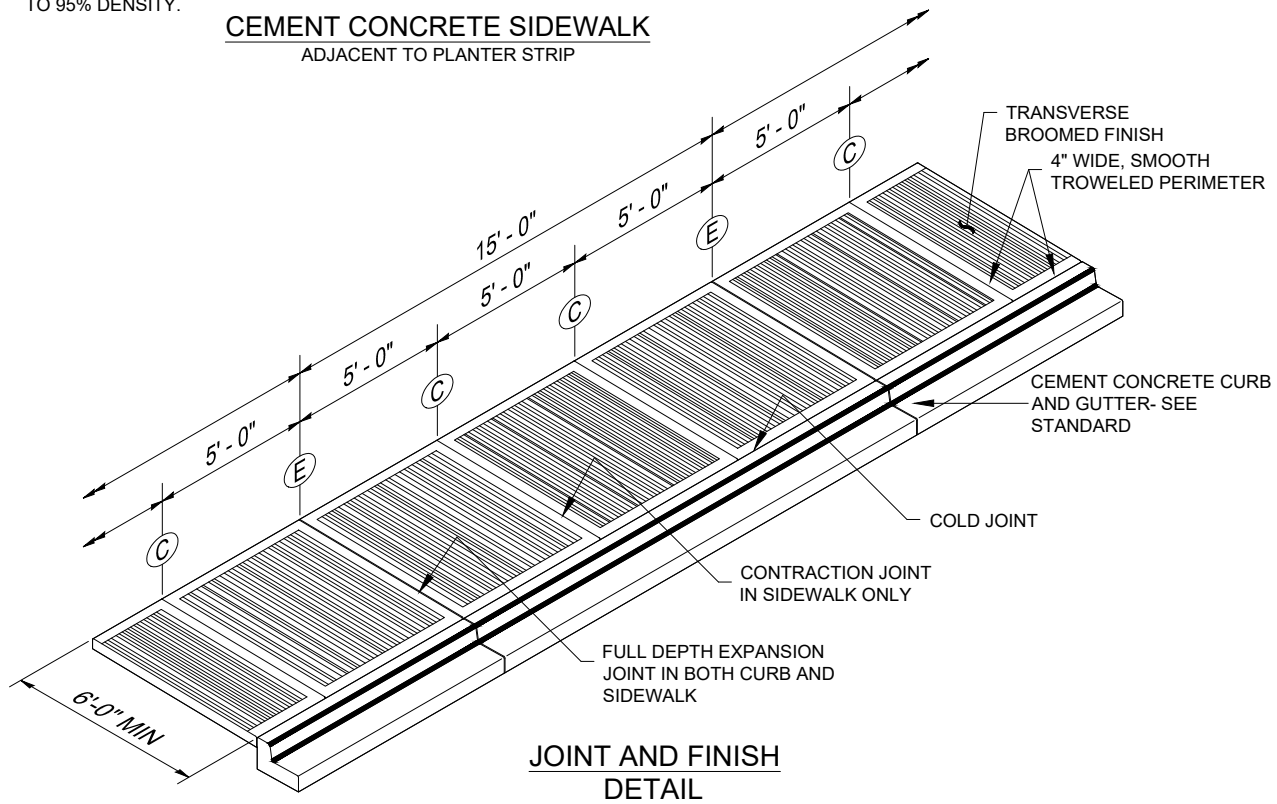

**JOINT AND FINISH  
DETAIL**

**NOTES:**

1. SIDEWALKS THROUGH CONCRETE DRIVEWAYS SHALL BE 6" THICK.
2. SIDEWALKS SHALL BE CLASS 3000 CEMENT CONCRETE.
3. SEE STANDARD DRAWING 3102 FOR SPECIFIC SIDEWALK REQUIREMENTS IN DOWNTOWN ZONE.
4. FORM AND SUBGRADE INSPECTION IS REQUIRED BEFORE PLACING CONCRETE.
5. CONCRETE SIDEWALKS SHALL BE CURED FOR 72 HRS. MIN.



**City of Bremerton**

**PUBLIC WORKS**

**ENGINEERING DIVISION**

**CONCRETE SIDEWALK DETAIL  
NON-DOWNTOWN LOCATIONS**

Alteration of this drawing is prohibited. Any approval of an altered drawing is unauthorized and void.

**3101**

Revision Date  
6.22.21