



PLAN
NTS

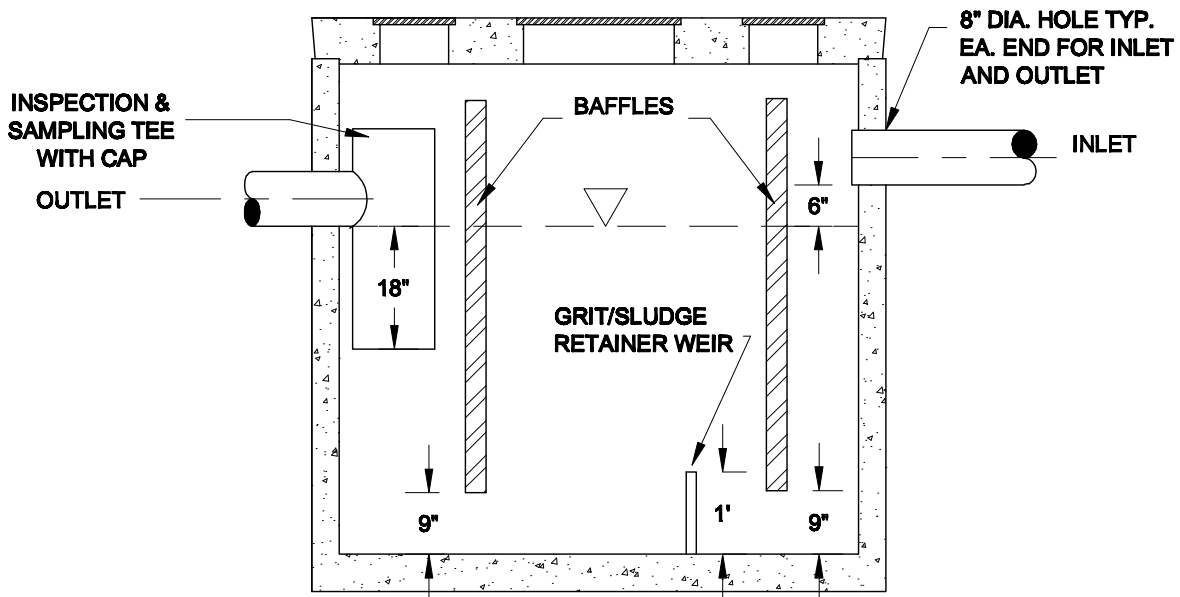

ELEVATION
NTS

NOTES:

1. UTILITY VAULT COMPANY, INC., #577-SA, OR EQUAL
2. LOCATE WITHIN 20 FEET OF DRIVE FOR ACCESS BY MAINTENANCE VEHICLE.
3. INSPECTION AND SAMPLING TEE TO BE INSTALLED BY CONTRACTOR. LINE-SIZED P.V.C. PIPE SHALL BE USED.
4. FILL WITH CLEAN WATER PRIOR TO START-UP OF SYSTEM.
5. GRAY AND BLACK WATER SHALL BE CARRIED BY SEPARATE SIDE SEWER.
6. SIZE WILL BE DETERMINED BY THE VOLUME TREATED.

	<p>City of Bremerton</p> <hr style="width: 50%; margin: 0 auto;"/> <p>PUBLIC WORKS</p>	<p>BAFFLE TYPE OIL/WATER SEPARATOR</p>	<p>6081</p>
<p>DESIGN/CONSTRUCTION STANDARDS</p>		<p>Alteration of this drawing is prohibited. Any approval of an altered drawing is unauthorized and void.</p>	<p>Revision Date 01/31/12</p>