


CONCRETE & DUCTILE PIPE

**NOTE:**

- ① CONCRETE PIPE SHALL BE BEDDED TO SPRING LINE.
- ② PIPE SHALL BE BEDDED AND INSTALLED PER WSDOT STANDARD SPECIFICATIONS SECTION 7-08.

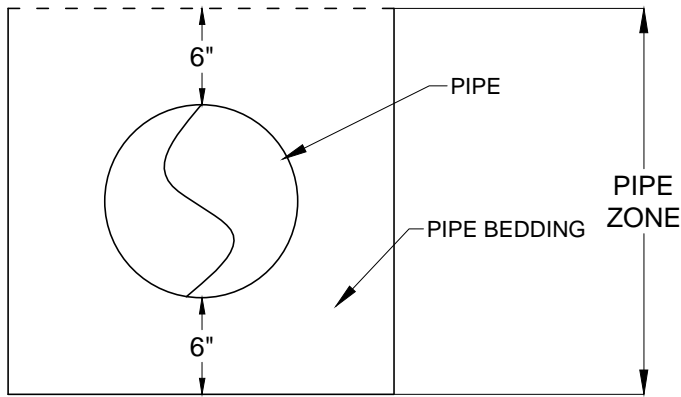


FLEXIBLE PIPE

PIPE BEDDING

WHEN PIPE BEDDING IS REQUIRED, REFERENCE WSDOT 9-03.12(3)


COMPACTION IN PIPE ZONE SHALL BE 90% OF MAXIMUM DENSITY. LOOSE LAYERS OF 6" OR LESS SHALL BE CAREFULLY COMPACTED. BACKFILL SHALL BE BROUGHT UP SIMULTANEOUSLY ON EACH SIDE OF PIPE TO TOP OF PIPE ZONE.

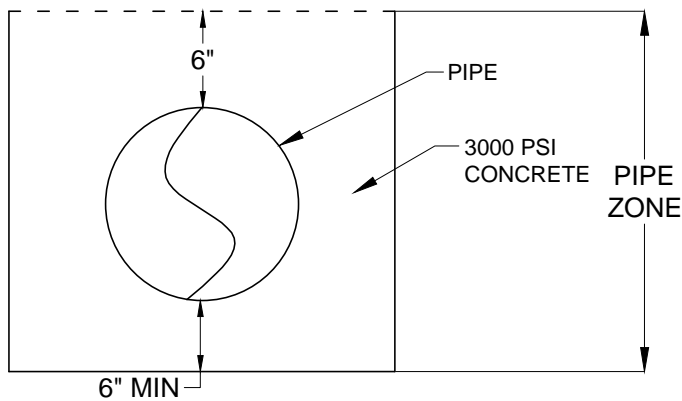

CONCRETE ENCASEMENT

**SEWER PIPE ZONE DETAILS**

NTS

	<p><b>City of Bremerton</b></p> <hr/> <p><b>PUBLIC WORKS</b></p> <hr/> <p><b>DESIGN/CONSTRUCTION STANDARDS</b></p>	<p><b>SEWER PIPE ZONE</b></p>	<p><b>6061</b></p>
		<p>Alteration of this drawing is prohibited. Any approval of an altered drawing is unauthorized and void.</p>	<p>Revision Date 09/24/14</p>