


NOTE: STANDARD POLE # TO BE ASSIGNED BY CITY OF BREMERTON ELECTRONICS



CONDUIT WIRING SCHEDULE					
RUN	CONDUIT SIZE	ILLUM.	GROUND	SERVICE	NOTES
△					
1	1" PVC			3 #6	XHHW
2	3/4" PVC		1 #6		
3	1 1/2" PVC		1 #8		
4	1 1/2" PVC	2 #8	1 #8		
5	1 1/2" PVC	2 #8	1 #8		
6	2" PVC				PULL STRING ONLY

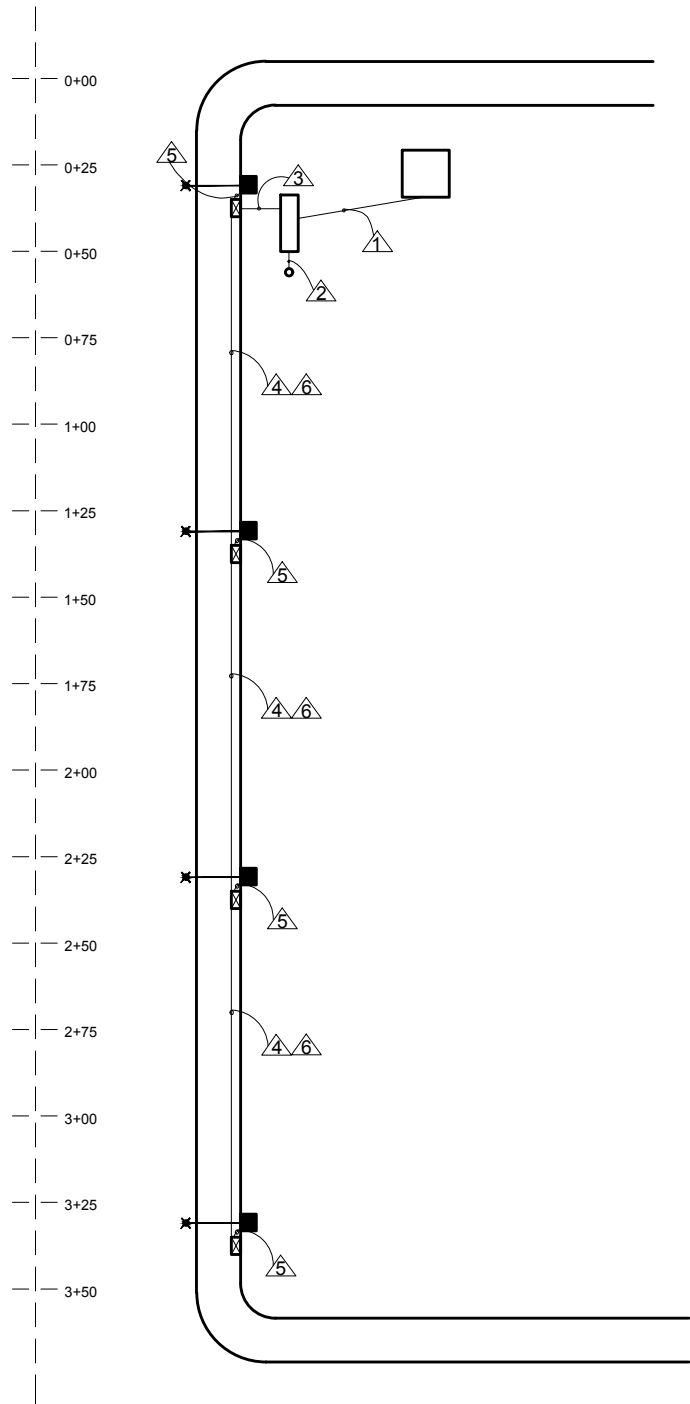

City of Bremerton

PUBLIC WORKS

ENGINEERING DIVISION

**FORMAT FOR SUBMITTAL DRAWINGS
SAMPLE STREET LIGHTING PLAN**

Alteration of this drawing is prohibited. Any approval of an altered drawing is unauthorized and void.

7008

Revision Date
08/01/17